


Integrated BOS main user interface

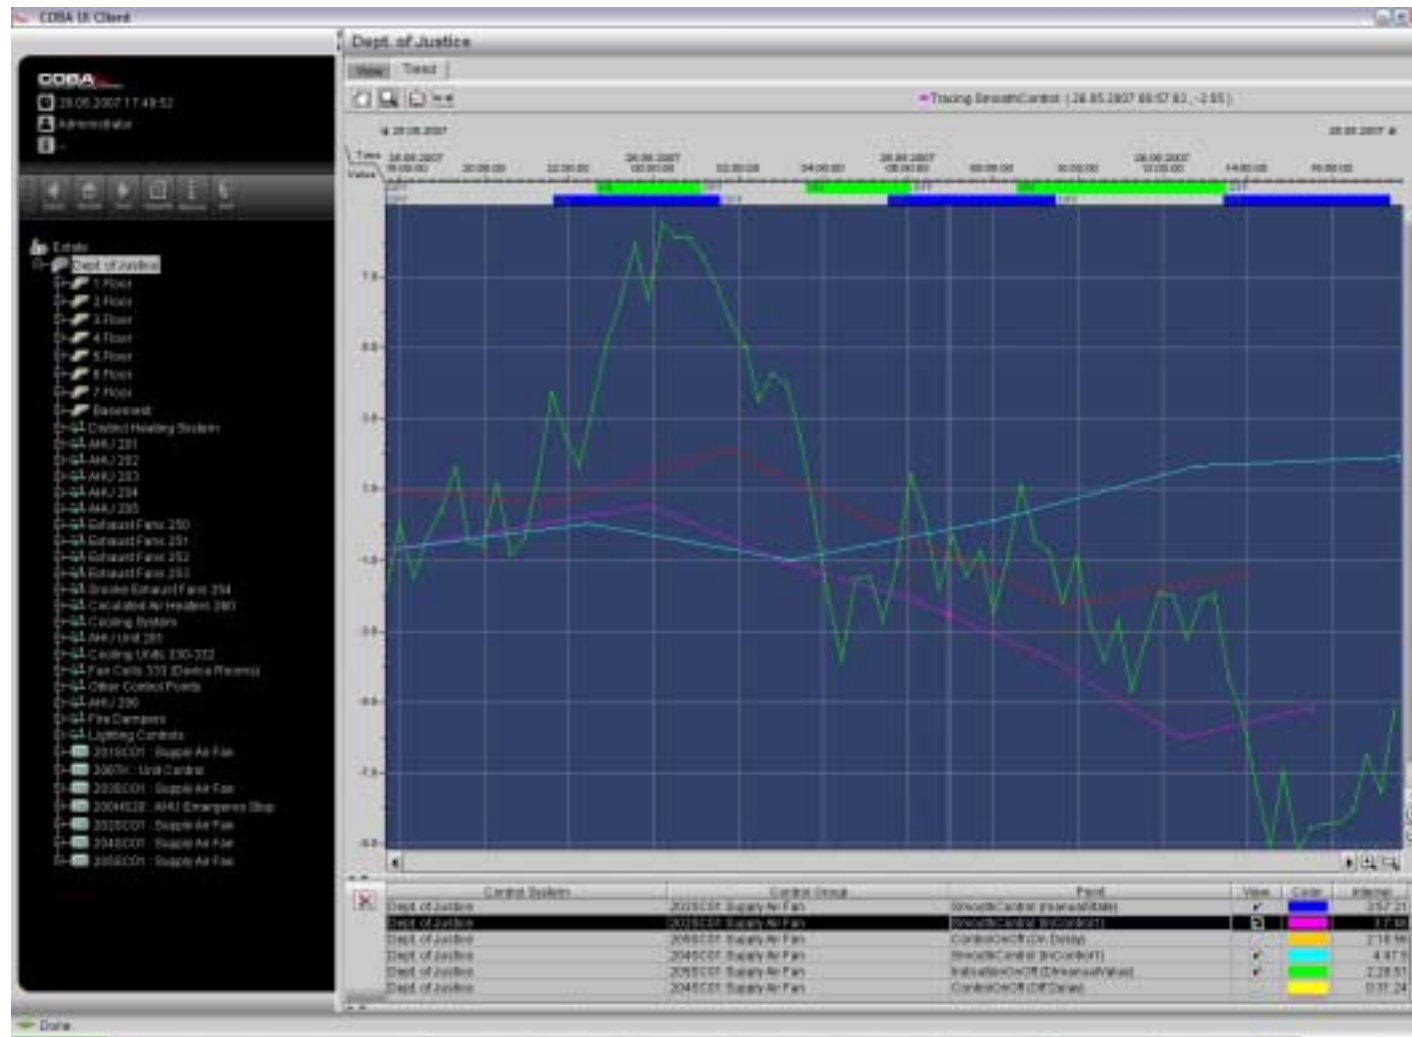

The screenshot displays the COBA 15 Client software interface for an HVAC system. The left sidebar shows a hierarchical tree view of the building's systems, with 'AHU 201' selected. The main window shows a detailed schematic of the AHU 201 system, including two horizontal air ducts with various components like fans, valves, and sensors. The schematic is color-coded with blue for air flow and red for water flow. Data points for temperature, pressure, and humidity are displayed throughout the system. A right-hand panel shows 'Room Temperature Reg.' set to 24.5 and 'AHU Estimated Oper.' at 2000. The bottom status bar shows 'Active Task' as 'SCHEDULING' and a table with columns for 'Point', 'Description', 'Value', 'Status', and 'Units'.

COBA 15 Client

COBA 15

27.05.2007 13:35:36
Administrator

Home View Add History Search Help

Entity

- Build of Justice
 - 1 Floor
 - 2 Floor
 - 3 Floor
 - 4 Floor
 - 5 Floor
 - 6 Floor
 - 7 Floor
 - Basement
 - 44 District Heating System
 - 44 AHU 201
 - 44 AHU 202
 - 44 AHU 203
 - 44 AHU 204
 - 44 AHU 205
 - 44 Exhaust Fans 200
 - 44 Exhaust Fans 201
 - 44 Exhaust Fans 202
 - 44 Exhaust Fans 203
 - 44 Exhaust Fans 204
 - 44 Circulated Air Heaters 202
 - 44 Cooling System
 - 44 AHU Unit 201
 - 44 Cooling Units 200-202
 - 44 Fan Cops 203 (Extra Pressure)
 - 44 Other Control Points
 - 44 AHU 206
 - 44 Free Cooling
 - 44 Lighting Controls
 - 201SC01 : Supply Air Fan
 - 200T01 : Unit Control
 - 200OC01 : Supply Air Fan
 - 200HS02 : AHU Emergency Stop
 - 202OC01 : Supply Air Fan
 - 204OC01 : Supply Air Fan
 - 205OC01 : Supply Air Fan

AHU 201

View Type

Time Schedules

Outdoor Temp: 13.0°C

Supply Air Temp: 20.0°C

Room Temperature Reg.: 24.5


AHU Estimated Oper.: 2000

6.7 Floor, and wing


Active Task: SCHEDULING

Point	Description	Value	Status	Units

Example: BOS maintenance view

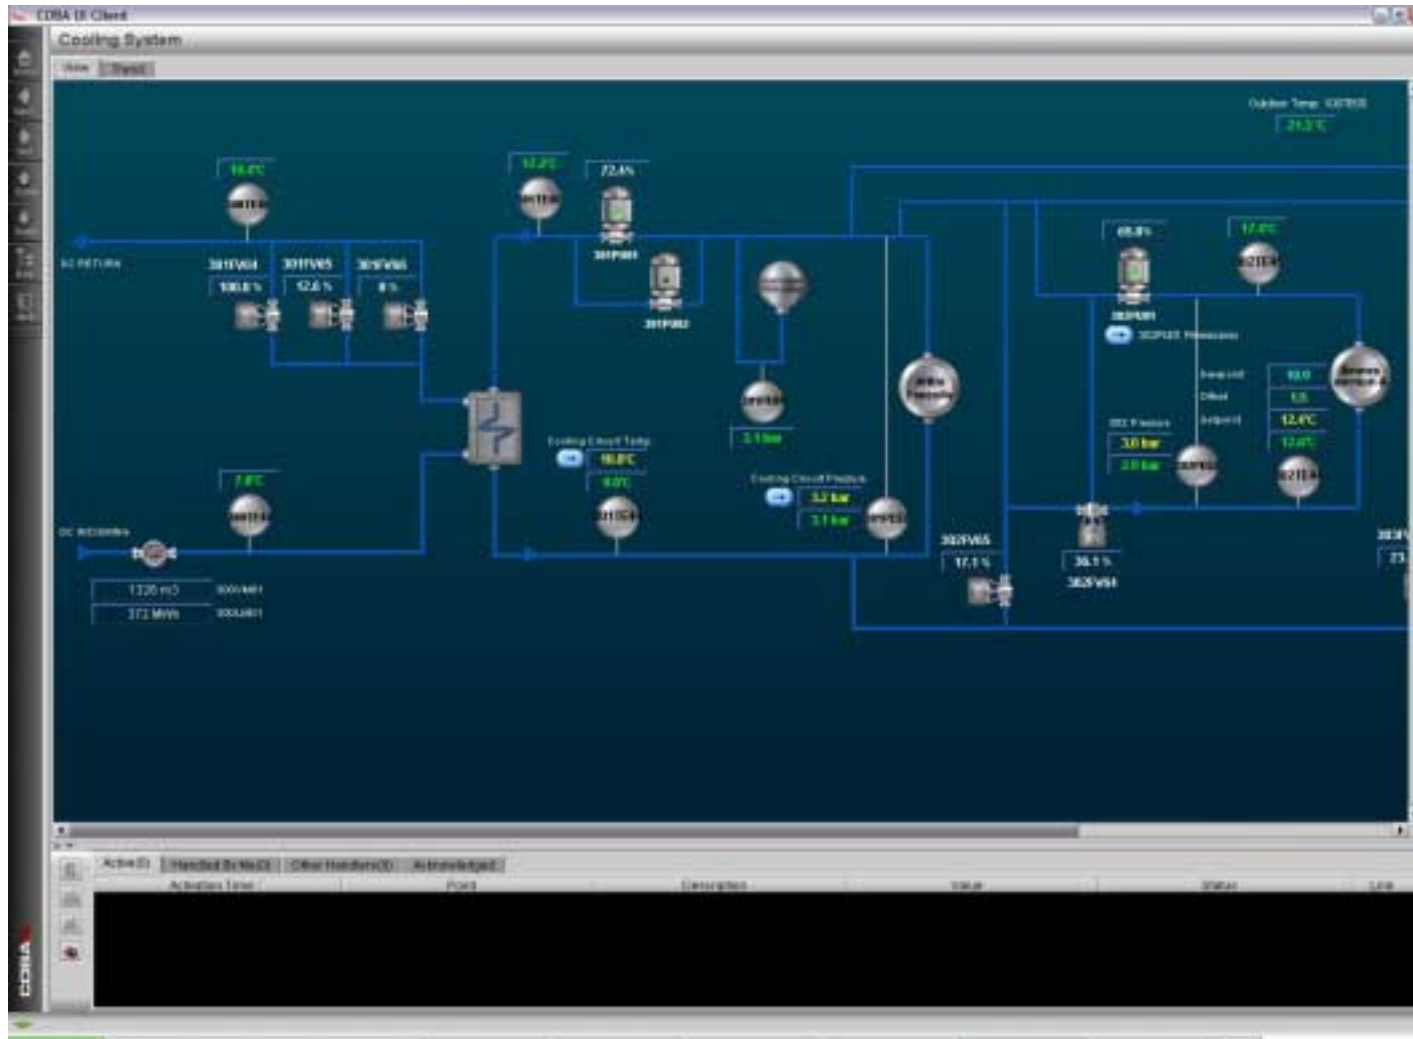

Example: BOS maintenance view

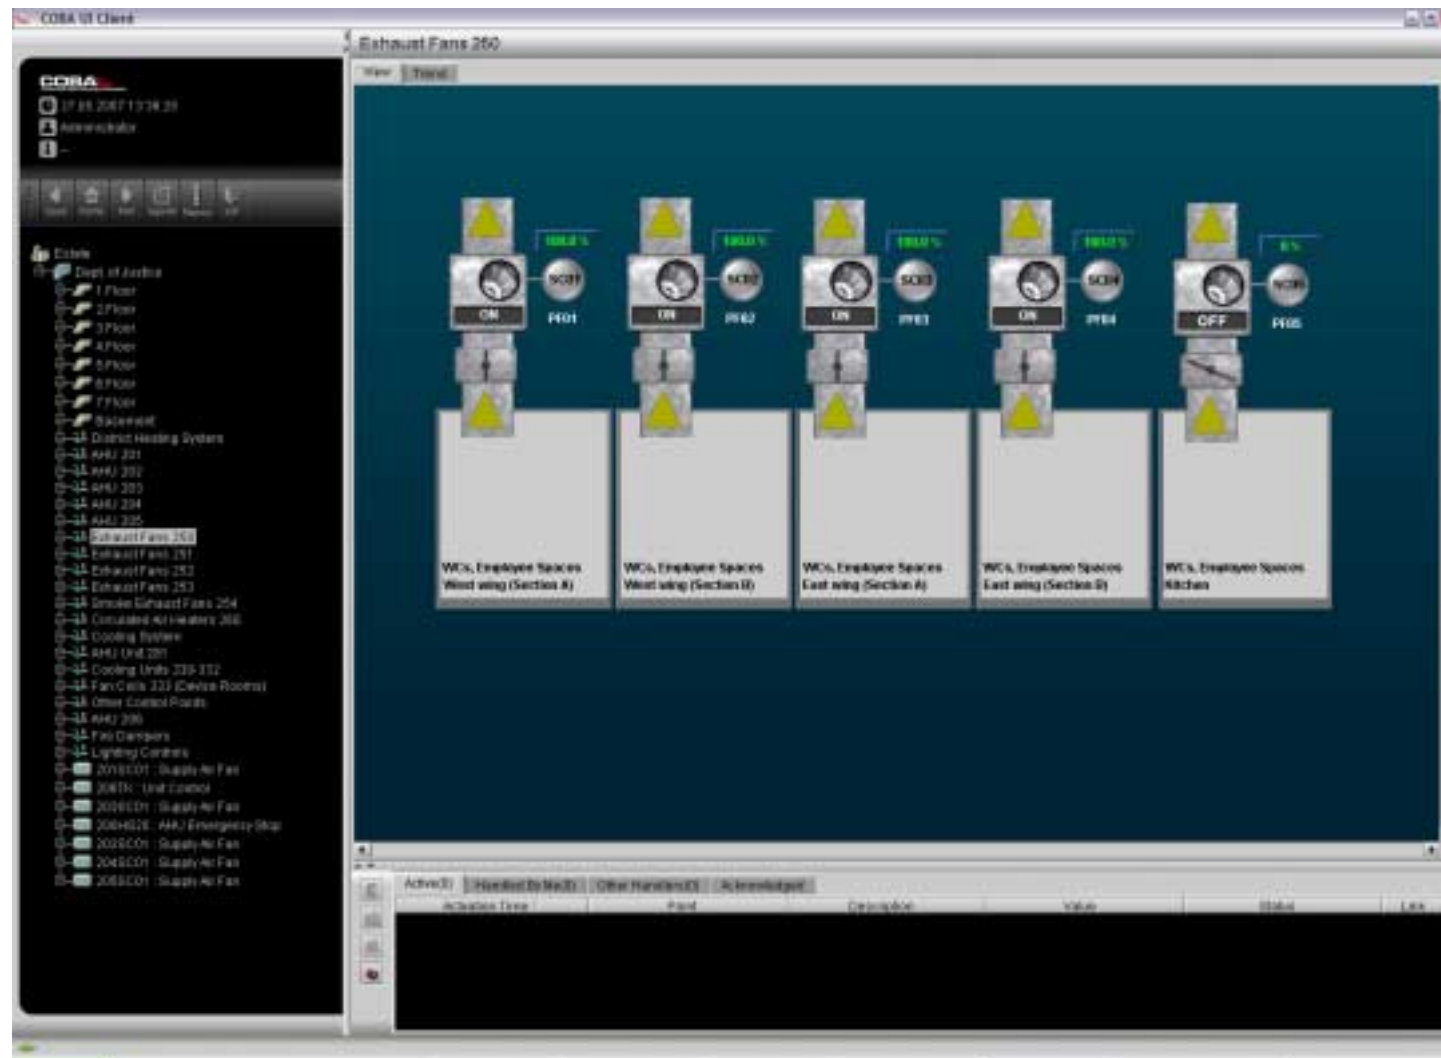

Example: Maintenance and security

Kesäranta

View Trend

KESÄRANTA

Pohjakerros

Piha

Active(2) Handled By Me(0) Other Handlers(0) Acknowledged

Activation Time	Point	Description	Value	Status	Link
05.07.2006 12:02:37	100-Raporttien terv...		value	ACTIVE_UNACK	
05.07.2006 12:00:27	Hilakoksidifazo		value	INACTIVE_UNACK	

2 krs





